



# Construction Guidelines - Communications Conduit

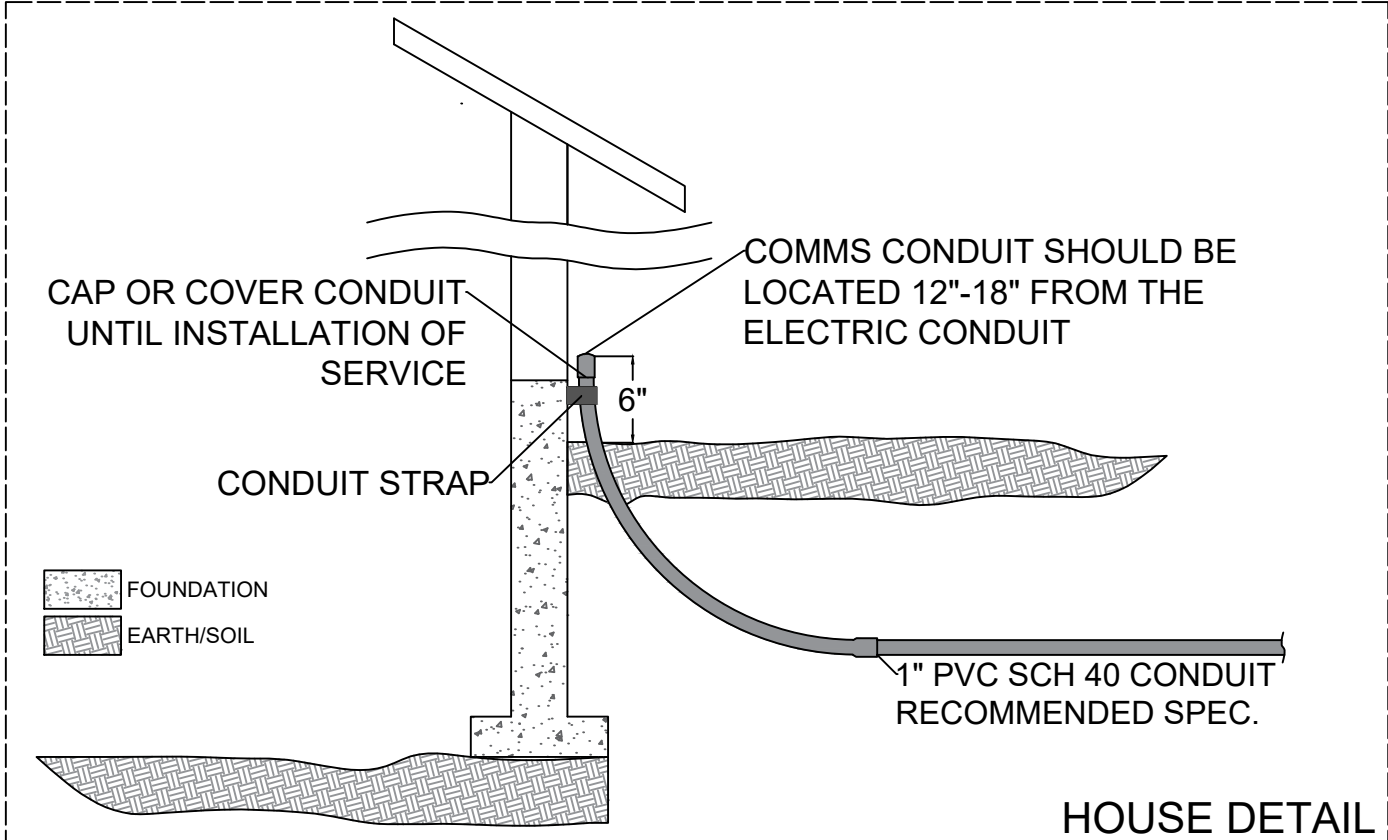

HOUSE DETAIL

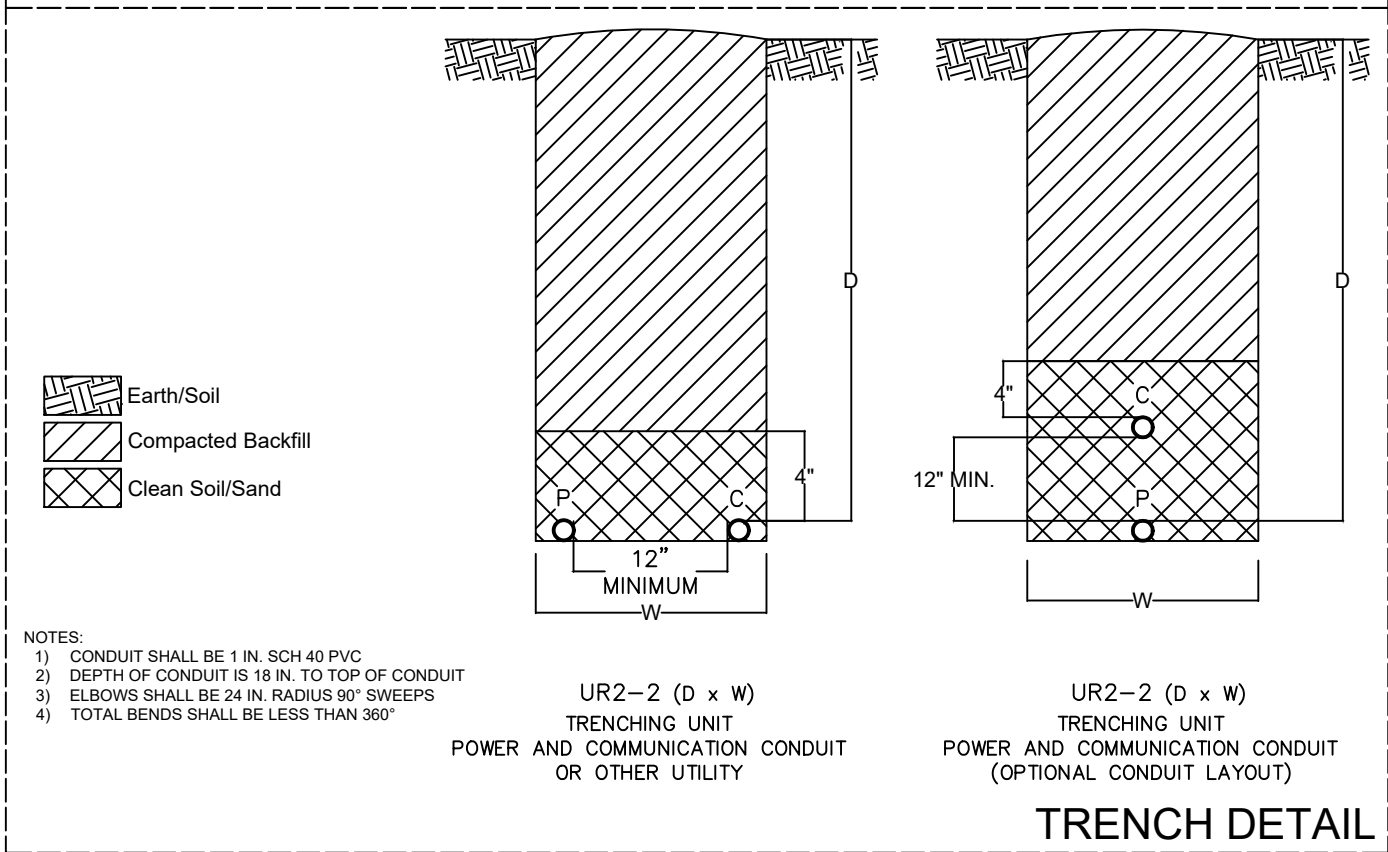


- NOTES:
- 1) CONDUIT SHALL BE 1 IN. SCH 40 PVC
  - 2) DEPTH OF CONDUIT IS 18 IN. TO TOP OF CONDUIT
  - 3) ELBOWS SHALL BE 24 IN. RADIUS 90° SWEEPS
  - 4) TOTAL BENDS SHALL BE LESS THAN 360°




JEFFERSON COUNTY PUD  
BROADBAND DEPARTMENT  
CUSTOMER GUIDELINES

GENERAL MANAGER	KEVIN STREETT	DRAWING GUIDELINES PG. 1
BROADBAND DIRECTOR	WILL O'DONNELL	
OSP ENGINEER	ERIK PRYOR	
REV: 0	DATE: 07/14/2023	DRAFTED BY: EAP

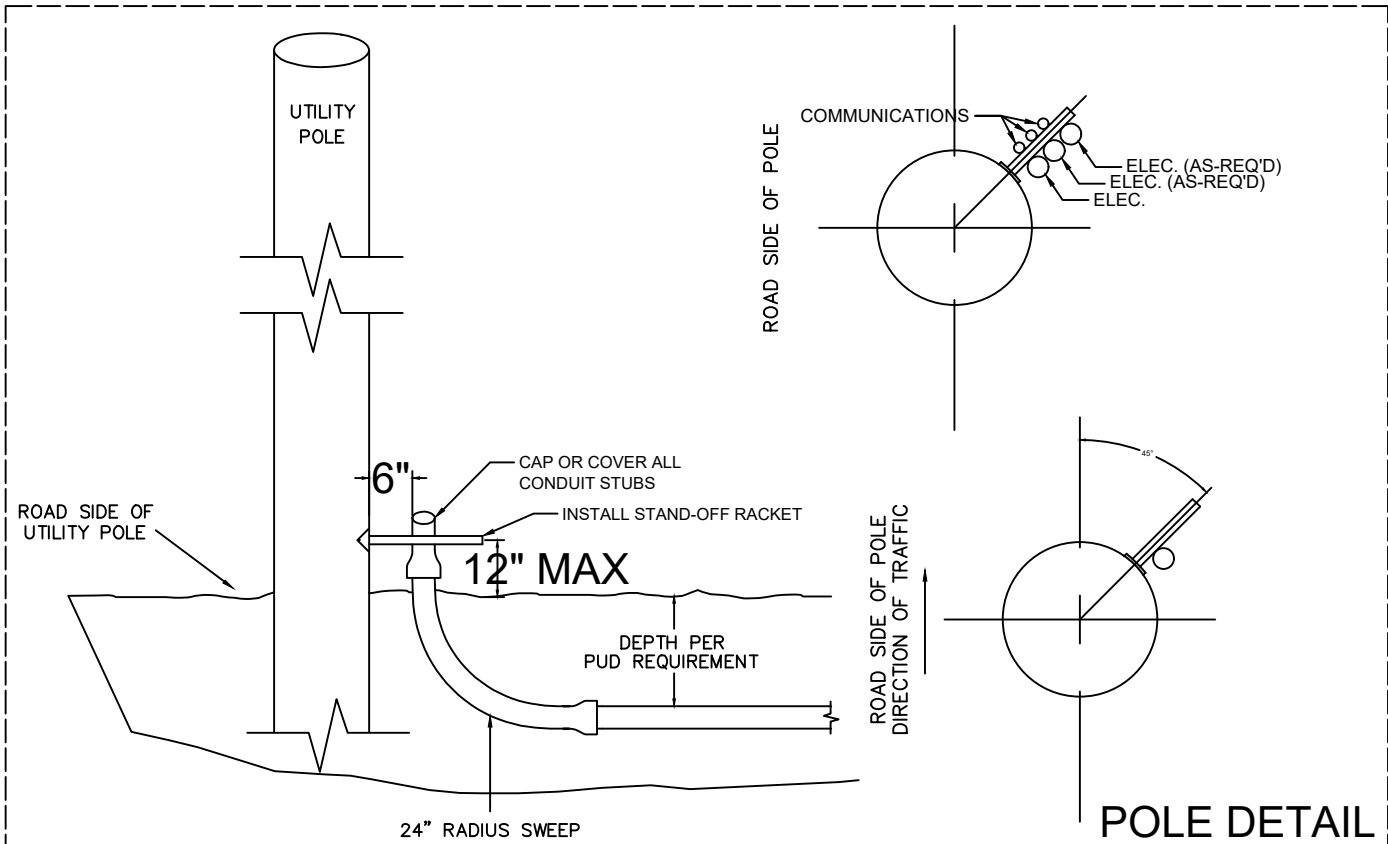

**POLE DETAIL**

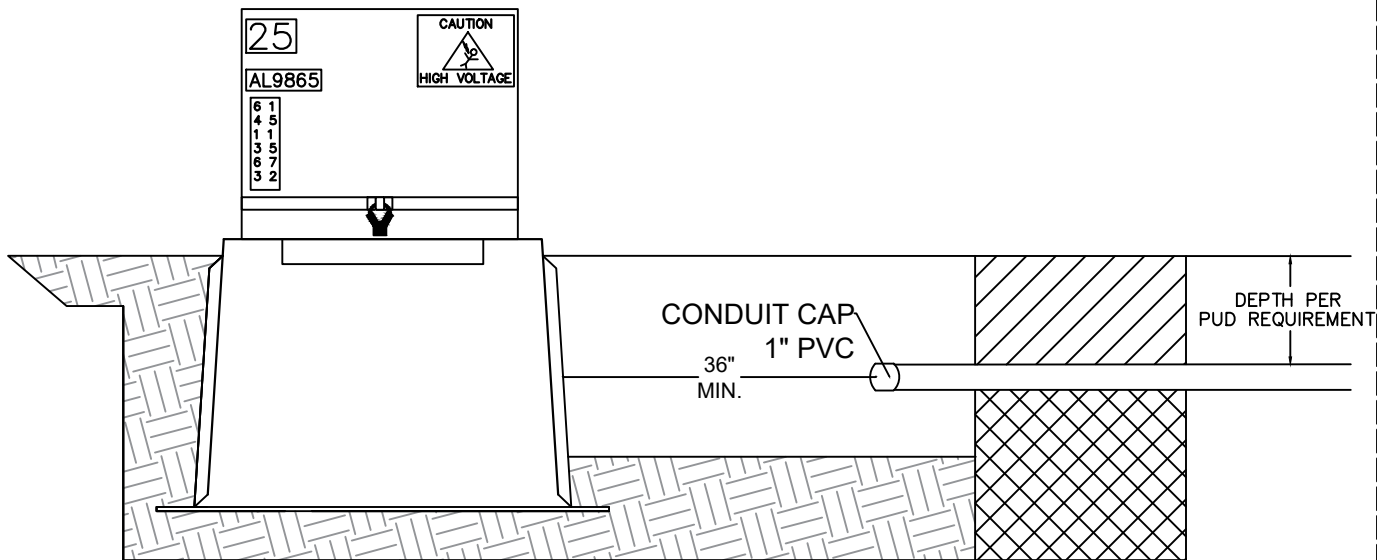

**PAD/VAULT DETAIL**

**NOTES:**

- 1) END OF CONDUIT SHALL BE 36 IN. FROM PUD PADMOUNT TRANSFORMER OR UTILITY VAULT.
- 2) CAP OR COVER END OF CONDUIT TO PREVENT SOIL/WATER INTRUSION INTO CONDUIT.



**JEFFERSON COUNTY PUD  
BROADBAND DEPARTMENT  
CUSTOMER GUIDELINES**

GENERAL MANAGER	KEVIN STREETT	DRAWING GUIDELINES PG. 2
BROADBAND DIRECTOR	WILL O'DONNELL	
OSP ENGINEER	ERIK PRYOR	
REV: 0	DATE: 07/14/2023	DRAFTED BY: EAP